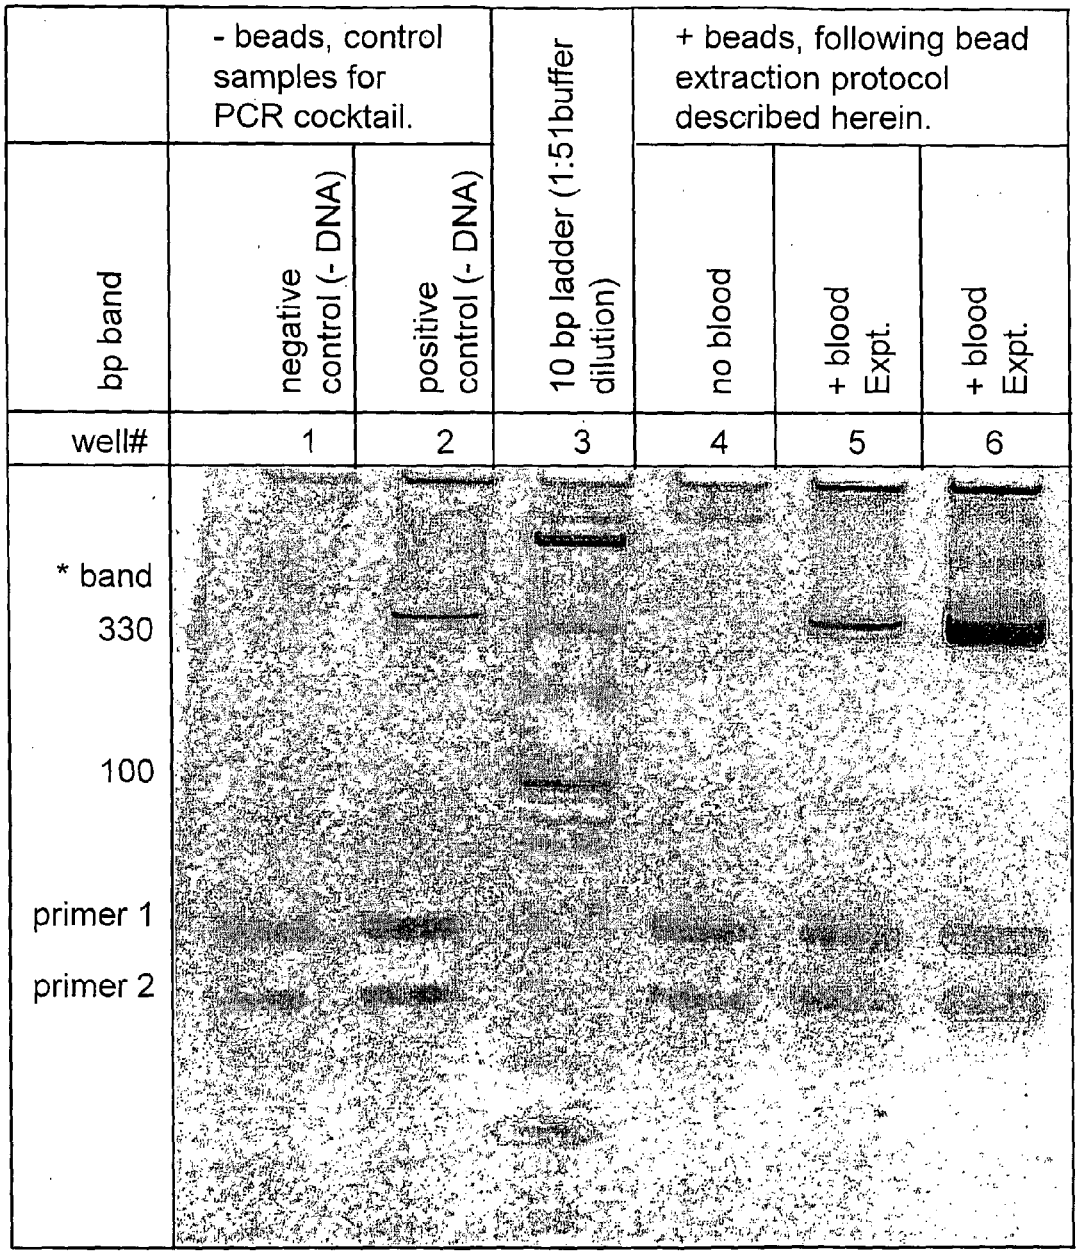
- beads, control samples for PCR cocktail.
10 bp ladder (1:51buffer dilution)
+ beads, following bead extraction protocol described herein.
bp band
negative control (- DNA)
positive control (- DNA)
no blood
+ blood Expt.
+ blood Expt.
well#
1
2
3
4
5
6
* band
330
100
primer 1
primer 2

FIG.2