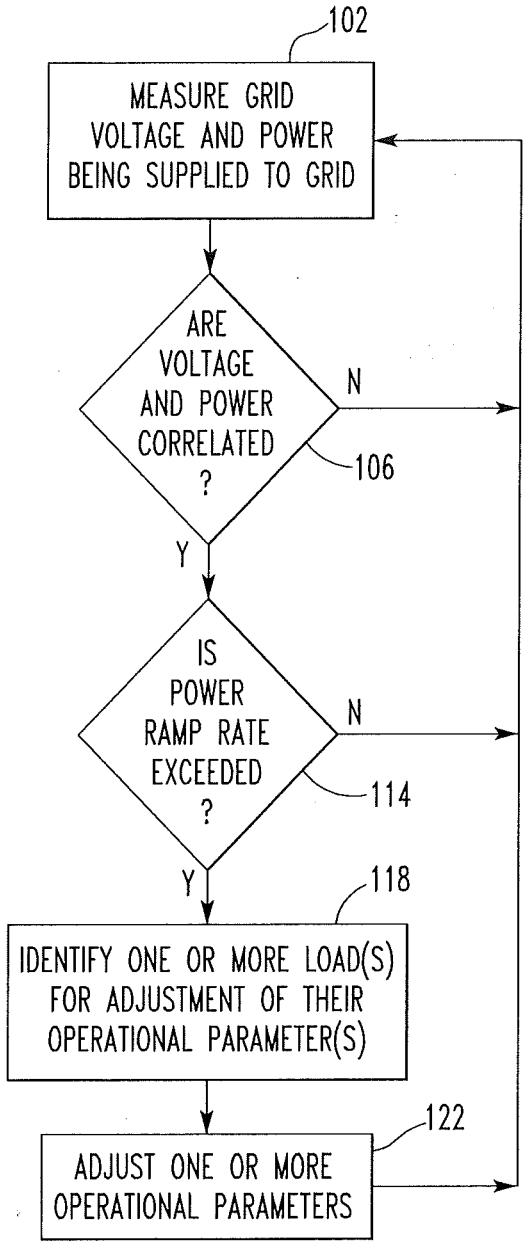
102
MEASURE GRID VOLTAGE AND POWER BEING SUPPLIED TO GRID
ARE VOLTAGE AND POWER CORRELATED ?
N
106
Y
IS POWER RAMP RATE EXCEEDED ?
N
114
Y
118
IDENTIFY ONE OR MORE LOAD(S) FOR ADJUSTMENT OF THEIR OPERATIONAL PARAMETER(S)
122
ADJUST ONE OR MORE OPERATIONAL PARAMETERS

FIG. 4