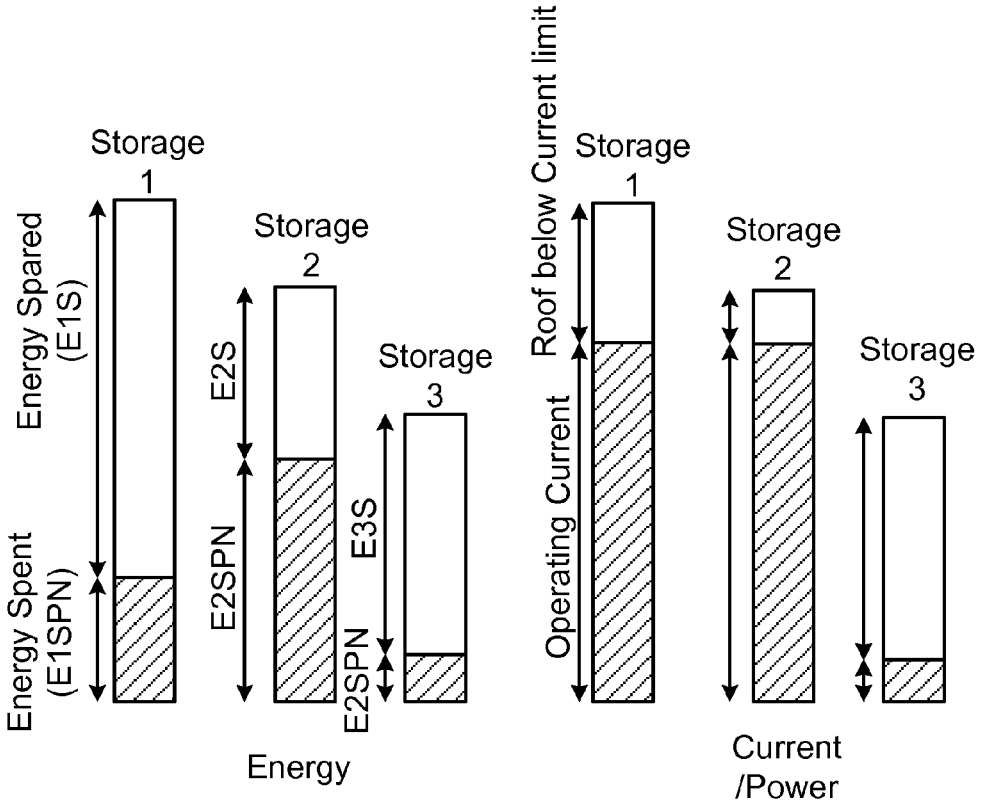
Storage 1
Storage 2
Storage 3
Energy Spared (E1S)
Energy Spent (E1SPN)
E2S
E2SPN
E3S
E2SPN
Energy
Roof below Current limit
Operating Current
Current /Power

Fig. 6

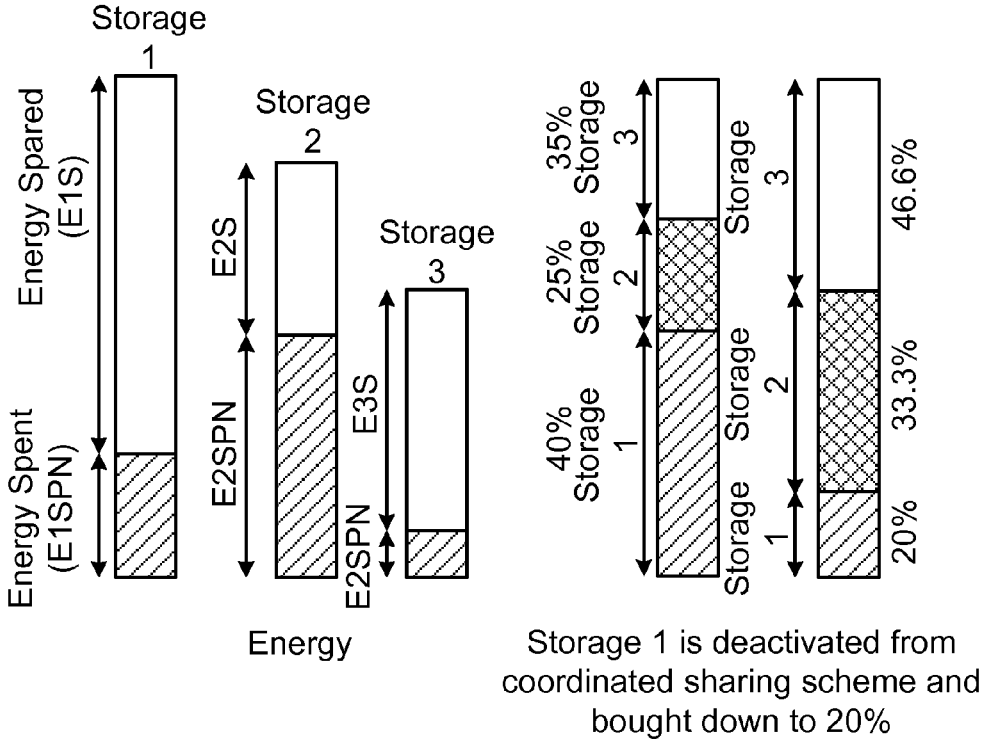
Storage 1
Storage 2
Storage 3
Energy Spared (E1S)
Energy Spent (E1SPN)
E2S
E2SPN
E3S
E2SPN
Energy
35% Storage 3
25% Storage 2
40% Storage 1
Storage 3
Storage 2
Storage 1
46.6%
33.3%
20%
Storage 1 is deactivated from coordinated sharing scheme and bought down to 20%

Fig. 7