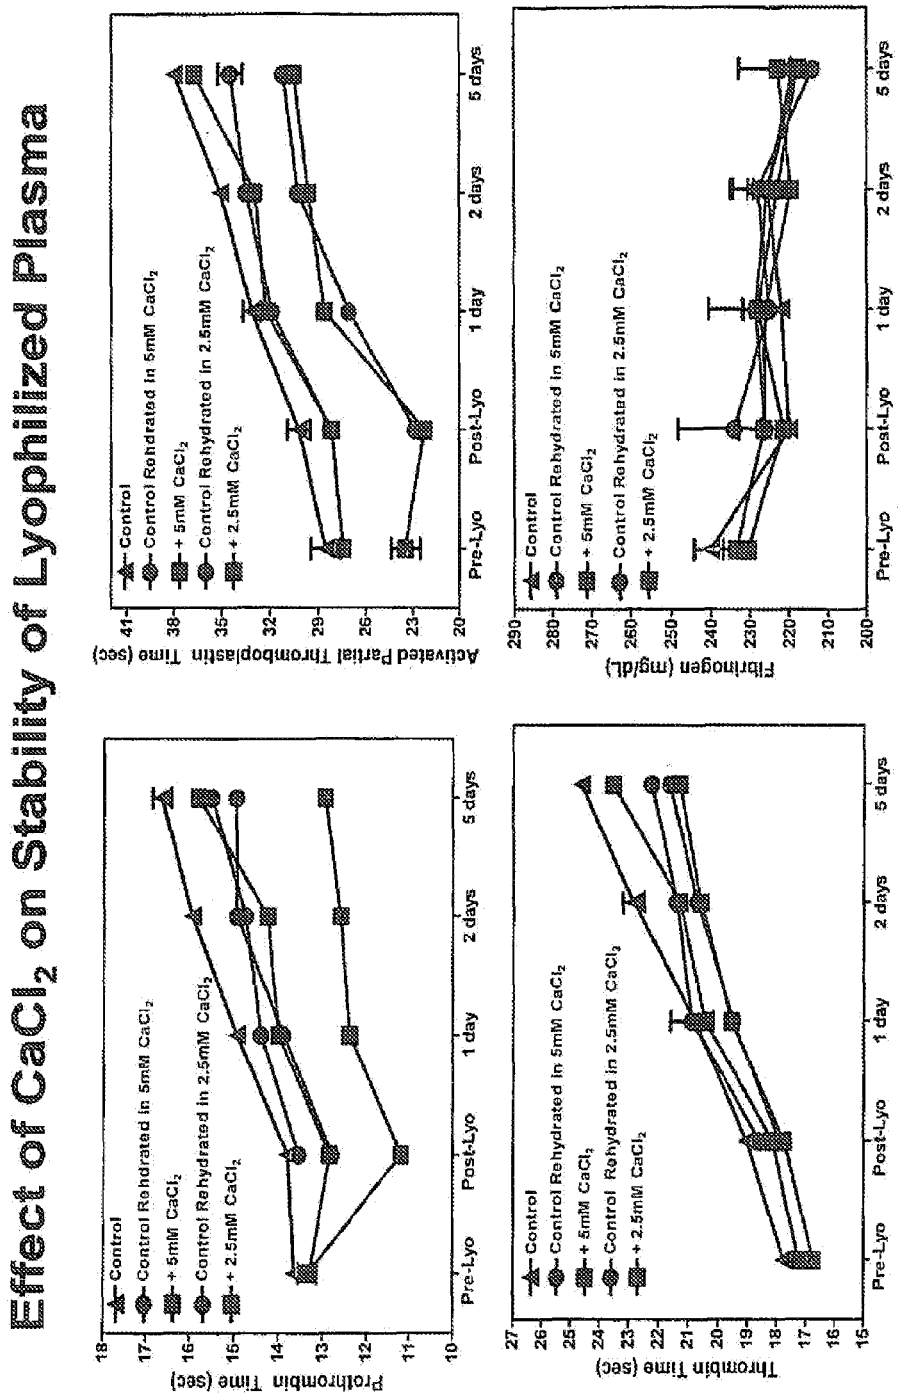
Effect of $CaCl_2$ on Stability of Lyophilized Plasma
Control
Control Rehydrated in 5mM $CaCl_2$
+ 5mM $CaCl_2$
Control Rehydrated in 2.5mM $CaCl_2$
+ 2.5mM $CaCl_2$
Prothrombin Time (sec)
Activated Partial Thromboplastin Time (sec)
Fibrinogen (mg/dL)
Thrombin Time (sec)
Pre-Lyo
Post-Lyo
1 day
2 days
5 days

FIGURE 2